



# Vent Hood® WALL MOUNT LINER INSERT SPECIFICATIONS

**BPSLD/BHPSLD LINER** "H" in part number indicates halogen lighting. This model not available with heat lamps.

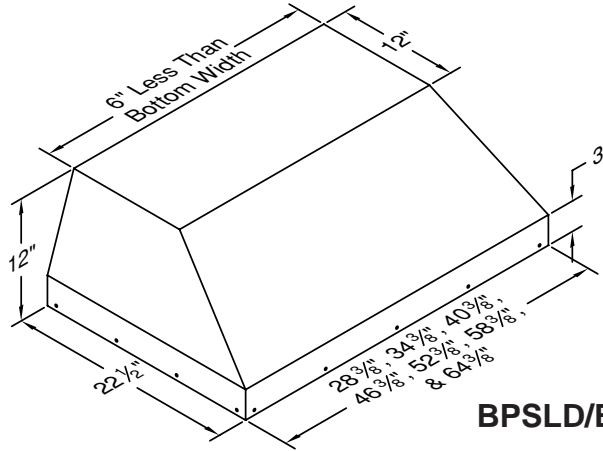


**BPSLD/BHPSLD**

## Connection Diagram (28 3/8" - 52 3/8" Widths)

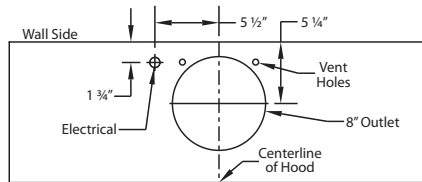


**600 CFM B200 Dual Blower (Top View)**

## Connection Diagram (46 3/8" - 58 3/8" Widths)

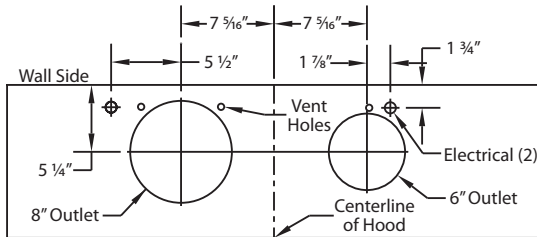


**900 CFM B200 Dual & B100 Single Blower (Top View)**

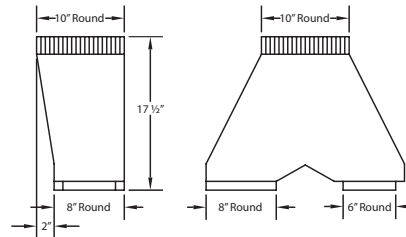


**VP562 Transition (Optional) For B300 (B200 Dual Blower & B100 Single Blower)**


## Connection Diagram (52 3/8" - 64 3/8" Widths)

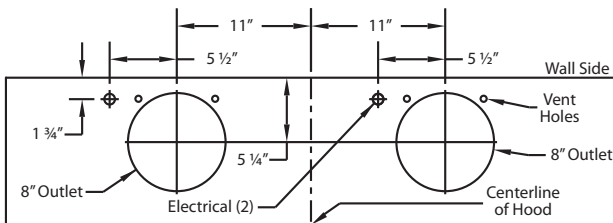

**1200 CFM Double B200 Dual Blowers (Top View)**

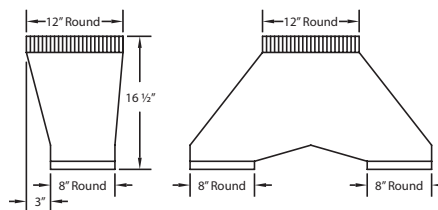


**VP563 Transition (Optional) For B400 (Double B200 Dual Blowers)**

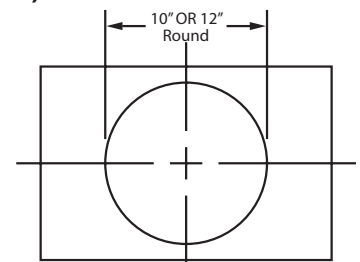

**VP562/VP563 transition centers outlet over top of hood**

## Recommended Mounting Height\*

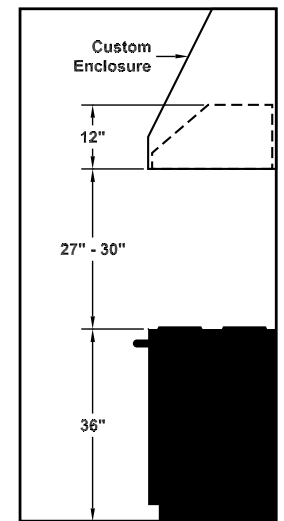

\*Exceeding recommended mounting height may compromise performance.

## Electrical/Mechanical Specifications For Blower Units

Model	Volts	Amps*	Hz	RPM	CFM SP@0.0"	Equivalent CFM*	CFM SP@0.1"	CFM SP@0.2"	CFM SP@0.3"	Minimum Round Duct Size	Sones#
B200 Dual	115	2.9	60	1550	600	900	531	480	430	8" (50 in. <sup>2</sup> )	6.5
B200 Dual & B100 Single	115	4.4	60	1550	900	1350	804	725	655	VP562: 10" (79 in. <sup>2</sup> )	6.3
Two B200 Duals	115	5.8	60	1550	1200	1800	1062	960	860	VP563: 12" (113 in. <sup>2</sup> )	6.6

\* Add 0.5 amp for each halogen light. Hoods are available with fluorescent light (one for each single or dual blower) or with halogen lights (2 lights: 30" - 41", 3 lights: 42" - 53", 4 lights: 54" - 66").  
 # Because the Magic Lung® blower uses centrifugal filtration rather than conventional baffle or mesh filters, the Magic Lung® blower can handle cooking equipment with higher cubic feet per minute (CFM) requirements and can deliver equivalent CFM much more efficiently than other filtration systems. When comparing the Magic Lung® with other blower units made by other manufacturers, use the "Equivalent CFM".  
 # Ratings in accordance with the Standard Test Code by the Energy Systems Laboratory of the Texas Engineering Experiment Station.

